




Modern Welding Company, Inc.

IOC "SuperVault" Aboveground Storage Tanks

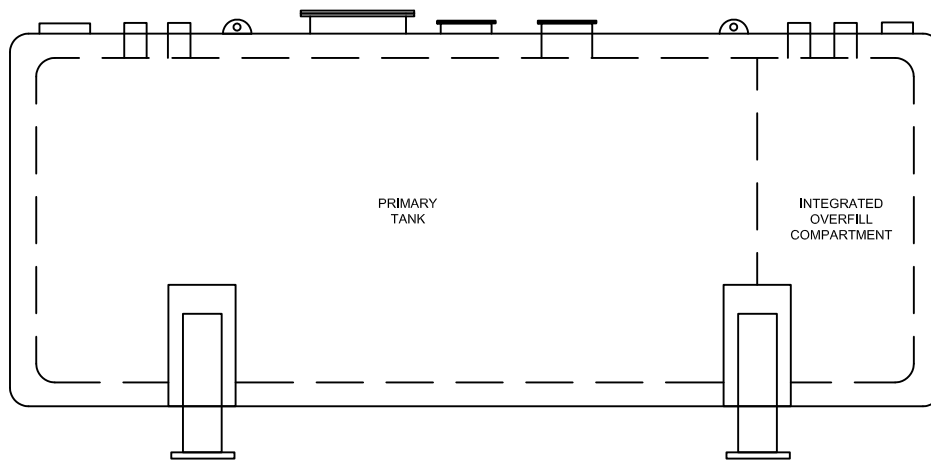

PRIMARY TANK W/ IOC COMPARTMENT			IOC COMPARTMENT	
APPROX. CAPACITY (GALLONS)	NOM. DIAMETER	NOM. LENGTH	NOM. LENGTH	NOM. CAPACITY (GALLONS)
750	51	173	17 $\frac{1}{4}$	75
1,000	64 $\frac{3}{8}$	129 $\frac{1}{2}$	13	100
1,500	64 $\frac{3}{8}$	187	17 $\frac{3}{4}$	150
2,000	64 $\frac{3}{8}$	244	24 $\frac{1}{2}$	200
2,000	77 $\frac{3}{4}$	158	15 $\frac{3}{4}$	200
3,000	77 $\frac{3}{4}$	229	23	300
4,000	77 $\frac{3}{4}$	300	30	400
4,000	96 $\frac{1}{2}$	187	18 $\frac{3}{4}$	400
5,000	96 $\frac{1}{2}$	229	23	500
6,000	96 $\frac{1}{2}$	272	27	600
6,000	128 $\frac{5}{8}$	148	15	600
8,000	128 $\frac{5}{8}$	193 $\frac{1}{2}$	19 $\frac{3}{4}$	800
10,000	128 $\frac{5}{8}$	243	24 $\frac{1}{4}$	1,000
12,000	128 $\frac{5}{8}$	287	28 $\frac{3}{4}$	1,200
15,000	128 $\frac{5}{8}$	351	35	1,500
20,000	128 $\frac{5}{8}$	462 $\frac{1}{2}$	46 $\frac{1}{2}$	2,000

Tank lengths listed above are based on nominal tank dimensions.
Overall tank lengths will vary during actual manufacturing.

STANDARD SPECIFICATIONS:

- Built in accordance with UL-2085 and Southwest Research Institute construction and testing standards.
- Tanks will bear SWRI label for "Insulated Secondary Containment for Flammable and Combustible Liquids-Protected Type".
- Inner and outer tank construction and thickness per UL-142.
- Modern's standard opening locations and required lifting lugs.
- Annular space monitoring capabilities.
- Supports can be saddles or skid configuration.
- Exterior blasted and finish coated white.
- Check with Modern for type of Emergency Vent Opening supplied.
- Other exterior and interior coatings systems may be available upon request.
- Other tank sizes available upon request.